Wiring Diagram

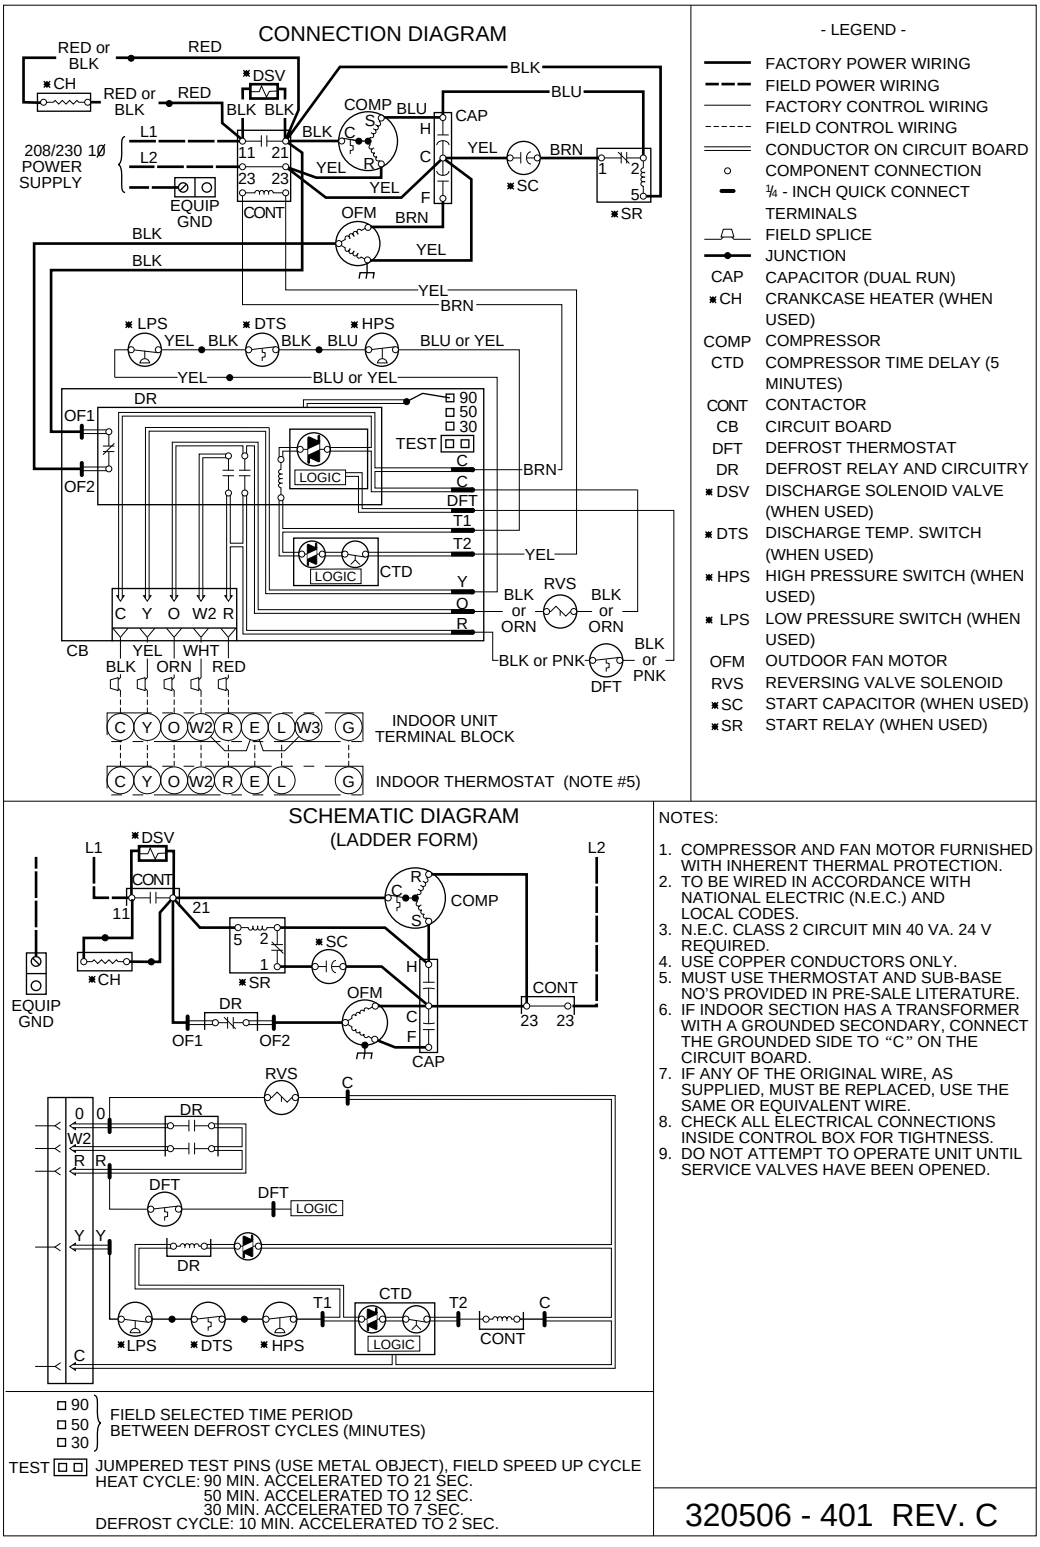

NOTES:

1. COMPRESSOR AND FAN MOTOR FURNISHED WITH INHERENT THERMAL PROTECTION.
2. TO BE WIRED IN ACCORDANCE WITH NATIONAL ELECTRIC (N.E.C.) AND LOCAL CODES.
3. N.E.C. CLASS 2 CIRCUIT MIN 40 VA. 24 V REQUIRED.
4. USE COPPER CONDUCTORS ONLY.
5. MUST USE THERMOSTAT AND SUB-BASE NO'S PROVIDED IN PRE-SALE LITERATURE.
6. IF INDOOR SECTION HAS A TRANSFORMER WITH A GROUNDED SECONDARY, CONNECT THE GROUNDED SIDE TO "C" ON THE CIRCUIT BOARD.
7. IF ANY OF THE ORIGINAL WIRE, AS SUPPLIED, MUST BE REPLACED, USE THE SAME OR EQUIVALENT WIRE.
8. CHECK ALL ELECTRICAL CONNECTIONS INSIDE CONTROL BOX FOR TIGHTNESS.
9. DO NOT ATTEMPT TO OPERATE UNIT UNTIL SERVICE VALVES HAVE BEEN OPENED.

320506 - 401 REV. C

A92430

Fig. 1—38YSA 208/230v, 1 Phase, 60 Hertz

Copyright 1996 CARRIER Corp. • 7310 W. Morris St. • Indianapolis, IN 46231

Manufacturer reserves the right to discontinue, or change at any time, specifications or designs without notice and without incurring obligations.

Book 1 4 Tab 5a 5a PC 101 Catalog No. 533-821 Printed in U.S.A. Form 38YSA-1W Pg 2 9-96 Replaces: New